



**Product Bulletin No.: PBF-601P**


***Outdoor Rated  
Basic Company Switch  
with Posi-Lok™***

***Features***

- 60A – 400A
- UL Listed
- Type 3R enclosure
- Powder coated scratch resistant finish
- Protection from weather and vandalism
- Lockable cable entry door on enclosure bottom
- 65k AIC @ 240V. molded case circuit breaker
- Standard rating – 3Ø 120/208V.
- Posi-Lok™ receptacle panel
- Phase voltage indicator lights
- Wire bending space as required by the NEC

***Options***

- Dual Neutral receptacles (200%)
- Parallel sets of receptacles
- Series 16 SafeCam™ receptacles
- Series 16 Cam receptacles
- Pin & Sleeve ( IEC 309) receptacles
- Isolated Ground
- Service entrance rating
- 1Ø 120V, 1Ø 120/240V.
- 3Ø 277/480V., 3Ø 208V., 3Ø 480V.
- Utility and Motor Branch circuits
- Digital Meter
- Custom laser engraved labeling
- Custom color
- Recessed, in-wall, mounting enclosure
- Pad / Freestanding enclosure
- Aluminum enclosure construction
- Type 4 construction
- Type 4X construction

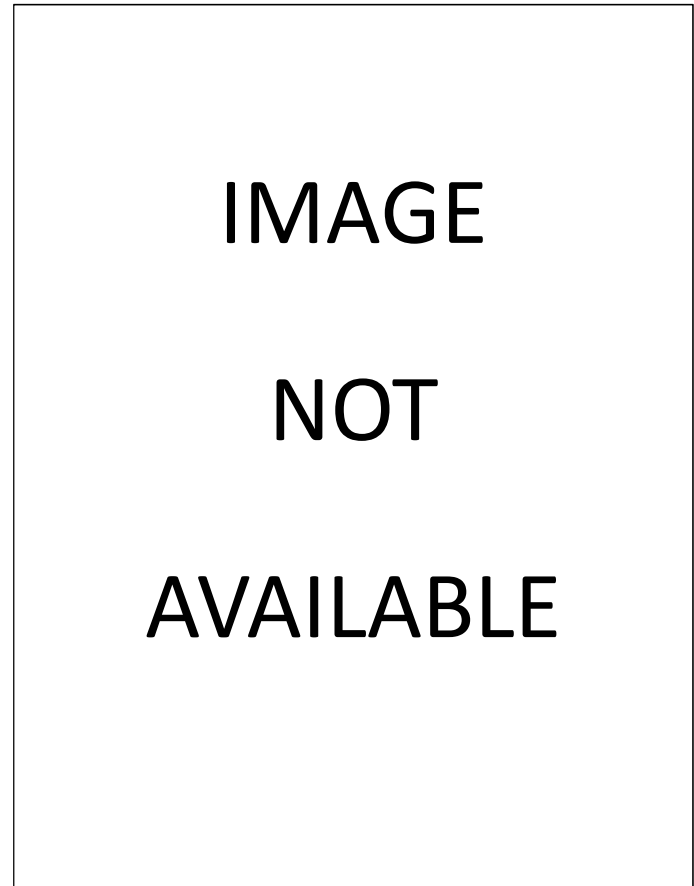



**Outdoor Rated  
Basic Company Switch  
with Posi-Lok™**

**Specifications**

1. The enclosure shall be Type 3R, fabricated from galvanized steel, and finished with a scratch resistant ANSI 61 Gray powder coating.
2. The dimensions shall be as listed (in inches):
 

Amps	Height	Width	Depth
60 – 100	36	24	8
200	36	24	8
400	44	24	8
3. The enclosure shall be provided with mounting tabs for surface mounting.
4. The enclosure shall have a main access door with a continuous hinge, a hasp to accept a padlock and a drip shield above the door.
5. A hinged door for entry of portable cable shall be located on the bottom of the enclosure. The cable entry door shall be secured by latch accessible only from inside the enclosure. Pad mounted enclosures may have the cable entry door located below the main access door on the front of the enclosure.
6. Conduit entry shall be through the top of the internal enclosure and the building wire shall terminate to mechanical lugs on the main circuit breaker, neutral bus and ground bus.
7. The mechanical lugs shall be dual rated (Al/Cu) and accommodate the building conductors as listed:
 

Amps	Phase	Neutral	Ground
60	#14AWG - 3/0AWG	#14AWG - 3/0AWG	#14AWG - 2/0AWG
100	#14AWG - 3/0AWG	#14AWG - 3/0AWG	#14AWG - 2/0AWG
200	#3AWG – 350kcmil	l# 6AWG - 300kcmil	#14AWG - 2/0 AWG
400	#2AWG – 500kcmil	l# 4AWG – 600kcmil	#14AWG - 2/0 AWG
- 8.. The main circuit breaker shall be a 3-pole, UL Listed 489 molded case type, with a current interrupt rating of 65kAIC @ 240V.
9. All connections from the main circuit breaker to the receptacles and from the receptacles to bus bar shall be copper conductors
10. The receptacle panel shall be Posi-Lok™ type, with color coded receptacle covers, and mounted on an internal dead front receptacle panel..
11. The device connection shall be made inside the Type 3R enclosure and the plugs shall remain inside the Type 3R enclosure while connected to the receptacles.
12. (3) red LED indicator lights shall be provided, (1) per phase, to show voltage present at each phase receptacle.
13. A warning label to specify the proper sequence for connection and removal of portable cable as shall be mechanically fastened to the dead front cover, above the series 16 receptacles, as required by NEC
14. The Company Switch shall have the option to be rated as service entrance equipment.
15. The Company Switch shall meet or exceed all applicable NEC standards and shall be UL Listed. A label denoting the UL Listing shall be permanently affixed to the unit.
16. The Company Switch shall be a PBS model as manufactured by Union Connector.



## Outdoor Rated Basic Company Switch with Posi-Lok™

<b>Standard Models</b>			
CATALOG NUMBER	PART NUMBER	BREAKER AMPACITY	RECEPTACLE TYPE
PBS-M0610W-P-3R	CSC-0610-P-3R	60A.	Posi-Lok™ EO200
PBS-M1010W-P-3R	CSC-1010-P-3R	100A.	Posi-Lok™ EO200
PBS-M2010W-P-3R	CSC-2010-P-3R	200A.	Posi-Lok™ EO200
PBS-M4020W-P-3R	CSC-4020-P-3R	400A.	Posi-Lok™ EO400

